




**ALLIED
MOULDED
PRODUCTS, Inc.**

**419-636-4217
222 N. Union St.
Bryan, OH 43506**

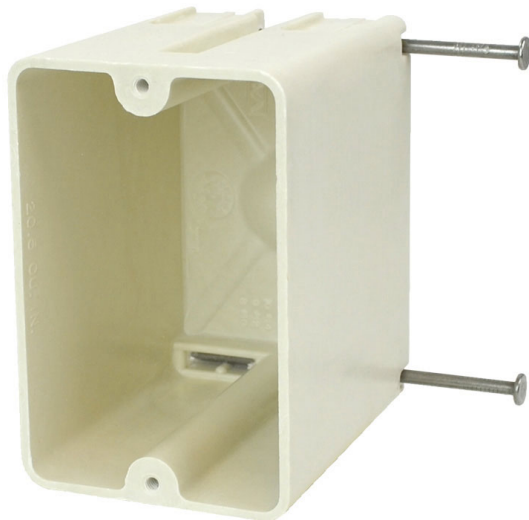

9327-N

Single gang electrical box for use with nonmetallic sheathed cable

Carton Quantity: 50

Mounting Description: Back nails

Box Type: Wall - Switch/Receptacle

Box Features: Nails

Installation Type: New Work

Height: 3-5/8 in

Width: 2-3/8 in

Depth: 3-1/4 in

Volume: 20.5 cu in

Number of Gangs: 1

Product Info

Brand: fiberglassBOX

UPC: 85339101956

UNSPSC: 39121308

Carton Weight: 17 lbs

Carton Length: 21 in

Carton Width: 10 in

Carton Height: 11 in

Country of Origin: United States of America

Color: Off white

Material: Fiberglass reinforced polyester

Additional Materials: Carbon steel fasteners

Features:

Machine tapped device holes, rigid hard box construction, no distortion with high temperatures, shatter resistant with low temperatures

Application:

New work residential construction 2 HR fire resistive walls & ceilings used with QUICKFLASH for exterior stucco wall fixtures and outlets, UL approved for back-to-back installation

Standards:

ANSI / UL 514C: File No E30594



WARNING - PROP 65

[Click here for more information!](#)

Fire Classification:

Fire Test of Building Construction Materials

ANSI / UL 263: File No. CEYY.R9379 (Category / File No.)

Note: Products must also be certified to: ANSI / UL 514C

Fire Resistance Classification in Wall Assemblies 2-Hours or less

For use in fire resistance walls constructed of min. 5-1/2 in. deep wood or nonbearing steel studs and gypsum wallboard and gypsum board with Classification periods of 2 hrs or less. Clearance between boxes and cutouts in wall shall not exceed 1/8 in. The area of openings for boxes shall not aggregate more than 100 sq in. per 100 sq ft of wall or partition area with no opening exceeding 22.0 sq in. *Outlet boxes with the suffix -N and -SS may be installed back to back on opposite sides of wall or partition.

**Applies to: 1096 (-N), (-SS); 1098 (-N); 1099 (-N), (-SS); and 9327 (-N)*

Fire Resistance Classification in Floor-Ceiling Assemblies 2-Hours or Less

Distance between boxes in adjacent cavities may be reduced to 5 ½ inches, excluding open web trusses

Note: For more details please refer to the UL fire resistive directory and Allied Moulded's CEYY.9379 (Outlet boxes and fittings classified for fire resistance.) See UL Product iQ document attached below.
