
ALLIED MOULDED PRODUCTS, Inc.

419-636-4217
222 N. Union St.
Bryan, OH 43506

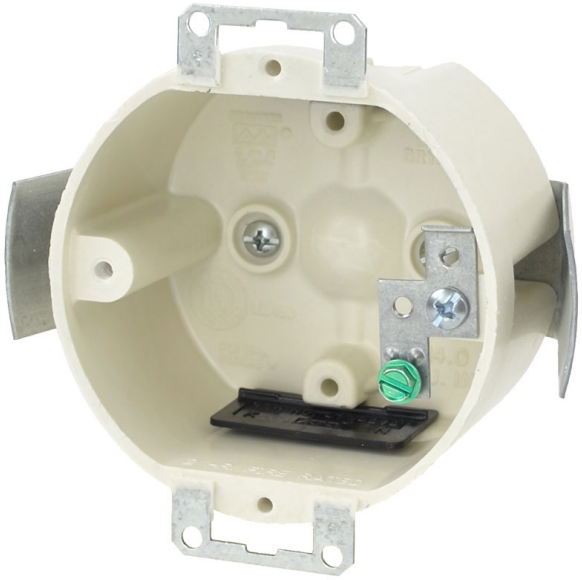

# 9338-ESGKT

3.5" dia. round fixture support (15 lbs.) box for use with nonmetallic sheathed cable

**Carton Quantity:** 50

**Mounting Description:** Snap bracket/metal ears wall compression

**Box Type:** Wall - Fixture Support

**Box Features:** Grounding strap, Metal ears, Snap bracket, Speed "K" nonmetallic clamps

**Installation Type:** Old Work

**Width:** 3-1/2 in

**Depth:** 2 in

**Volume:** 14 cu in

**Fixture Rating:** 15lbs

## Product Info

**Brand:** fiberglassBOX

**UPC:** 85339460435

**UNSPSC:** 39121308

**Carton Weight:** 21 lbs

**Carton Length:** 19 in

**Carton Width:** 9 in

**Carton Height:** 12 in

**Country of Origin:** United States of America

**Color:** Off white

**Material:** Fiberglass reinforced polyester

**Additional Materials:** Galvanized ground strap with plated carbon steel fastener and green plated carbon steel ground screw, Galvanized steel brackets and plated carbon steel fasteners, Polyvinyl chloride clamps

**Box Diameter:** 3.5

**Features:**

Machine tapped fixture holes and device holes, ground strap, rigid hard box construction, no distortion with high temperatures, shatter resistant with low temperatures, Speed “K” Clamps factory installed

**Application:**

Old work residential construction 2 HR fire resistive walls (15 lbs fixture support)

**Box Diameter:** 3.5

**Standards:**

ANSI / UL 514C: File No. E30594

UL LISTED

**WARNING** – PROP 65
Click here for more information!

**Fire Classification:**

**Fire Test of Building Construction Materials**

ANSI / UL 263: File No. CEYY.R9379 (Category / File No.)
Note: Products must also be certified to: ANSI / UL 514C

**Fire Resistance Classification in Wall Assemblies 2-Hours or less**

Shall be separated by a horizontal distance of not less than 3 inches

**Fire Resistance Classification in Floor-Ceiling Assemblies 2-Hours or Less**

Distance between boxes in adjacent cavities may be reduced to 5 ½ inches

*Note: For more details please refer to the UL fire resistive directory and Allied Moulded's CEYY.9379 (Outlet boxes and fittings classified for fire resistance)*